

Our Ref: 28349752 14481 Great Chesterford

Monday, 30 January 2023

Margarita Ivanova
Lancaster Gate Lancaster Gate

London
w2 3lp

National Grid House
Warwick Technology Park
Gallows Hill, Warwick
CV34 6DA

Electricity Emergency Number:
0800 40 40 90*
*Available 24 hours, 7 days/week.
Calls may be recorded and monitored.
www.nationalgrid.com

Asset Protection
Gas Transmission
National Grid
Warwick
Email: assetprotection@nationalgrid.com

National Grid Electricity – No Assets Affected

Dear Sir/ Madam,

An assessment has been carried out with respect to NGET apparatus and the proposed work location. Based on the search area entered in the LSBUD system for assessment the search area has been found to not affect any NGET apparatus.

Please note this response and any attached map(s) are valid for 28 days

Yours sincerely

Asset Protection Team

Your Responsibilities and Obligations


It is your responsibility to ensure that the information you have submitted is accurate and that all relevant documents including links are provided to all persons (either direct labour or contractors) working for you near National Grid Electricity Transmission plc's apparatus, as legally required including under the Construction (Design and Management) Regulations 2015.

The assessment solely relates to the physical apparatus of National Grid Electricity Transmission plc (NGET)
It does **NOT** cover:

- Apparatus owned by other people or organisations, e.g., Cadent, other gas distribution operators, local electricity companies, other utilities, landowners etc
- Apparatus owned by National Grid Gas plc.
- NGET's legal rights and interests (such as those contained in easements or wayleaves) in or concerning the land, which restrict activity in proximity to NGET's assets in private land. You must obtain details of any such restrictions from the landowner in the first instance and/or from HM Land Registry and/or you should seek legal advice. If in doubt, contact Asset Protection.

It is **YOUR** responsibility to consider whether any of the items or factors listed above may be present or relevant and if they could be affected by your proposed activities.


NGET or its agents, servants or contractors do not accept any liability for any losses arising under or in connection with this information. This limit on liability applies to all and any claims in contract, tort (including negligence), misrepresentation (excluding fraudulent misrepresentation), breach of statutory duty or otherwise. This limit on liability does not exclude or restrict liability, which is prohibited by law, nor does it supersede the express terms of any related agreements.

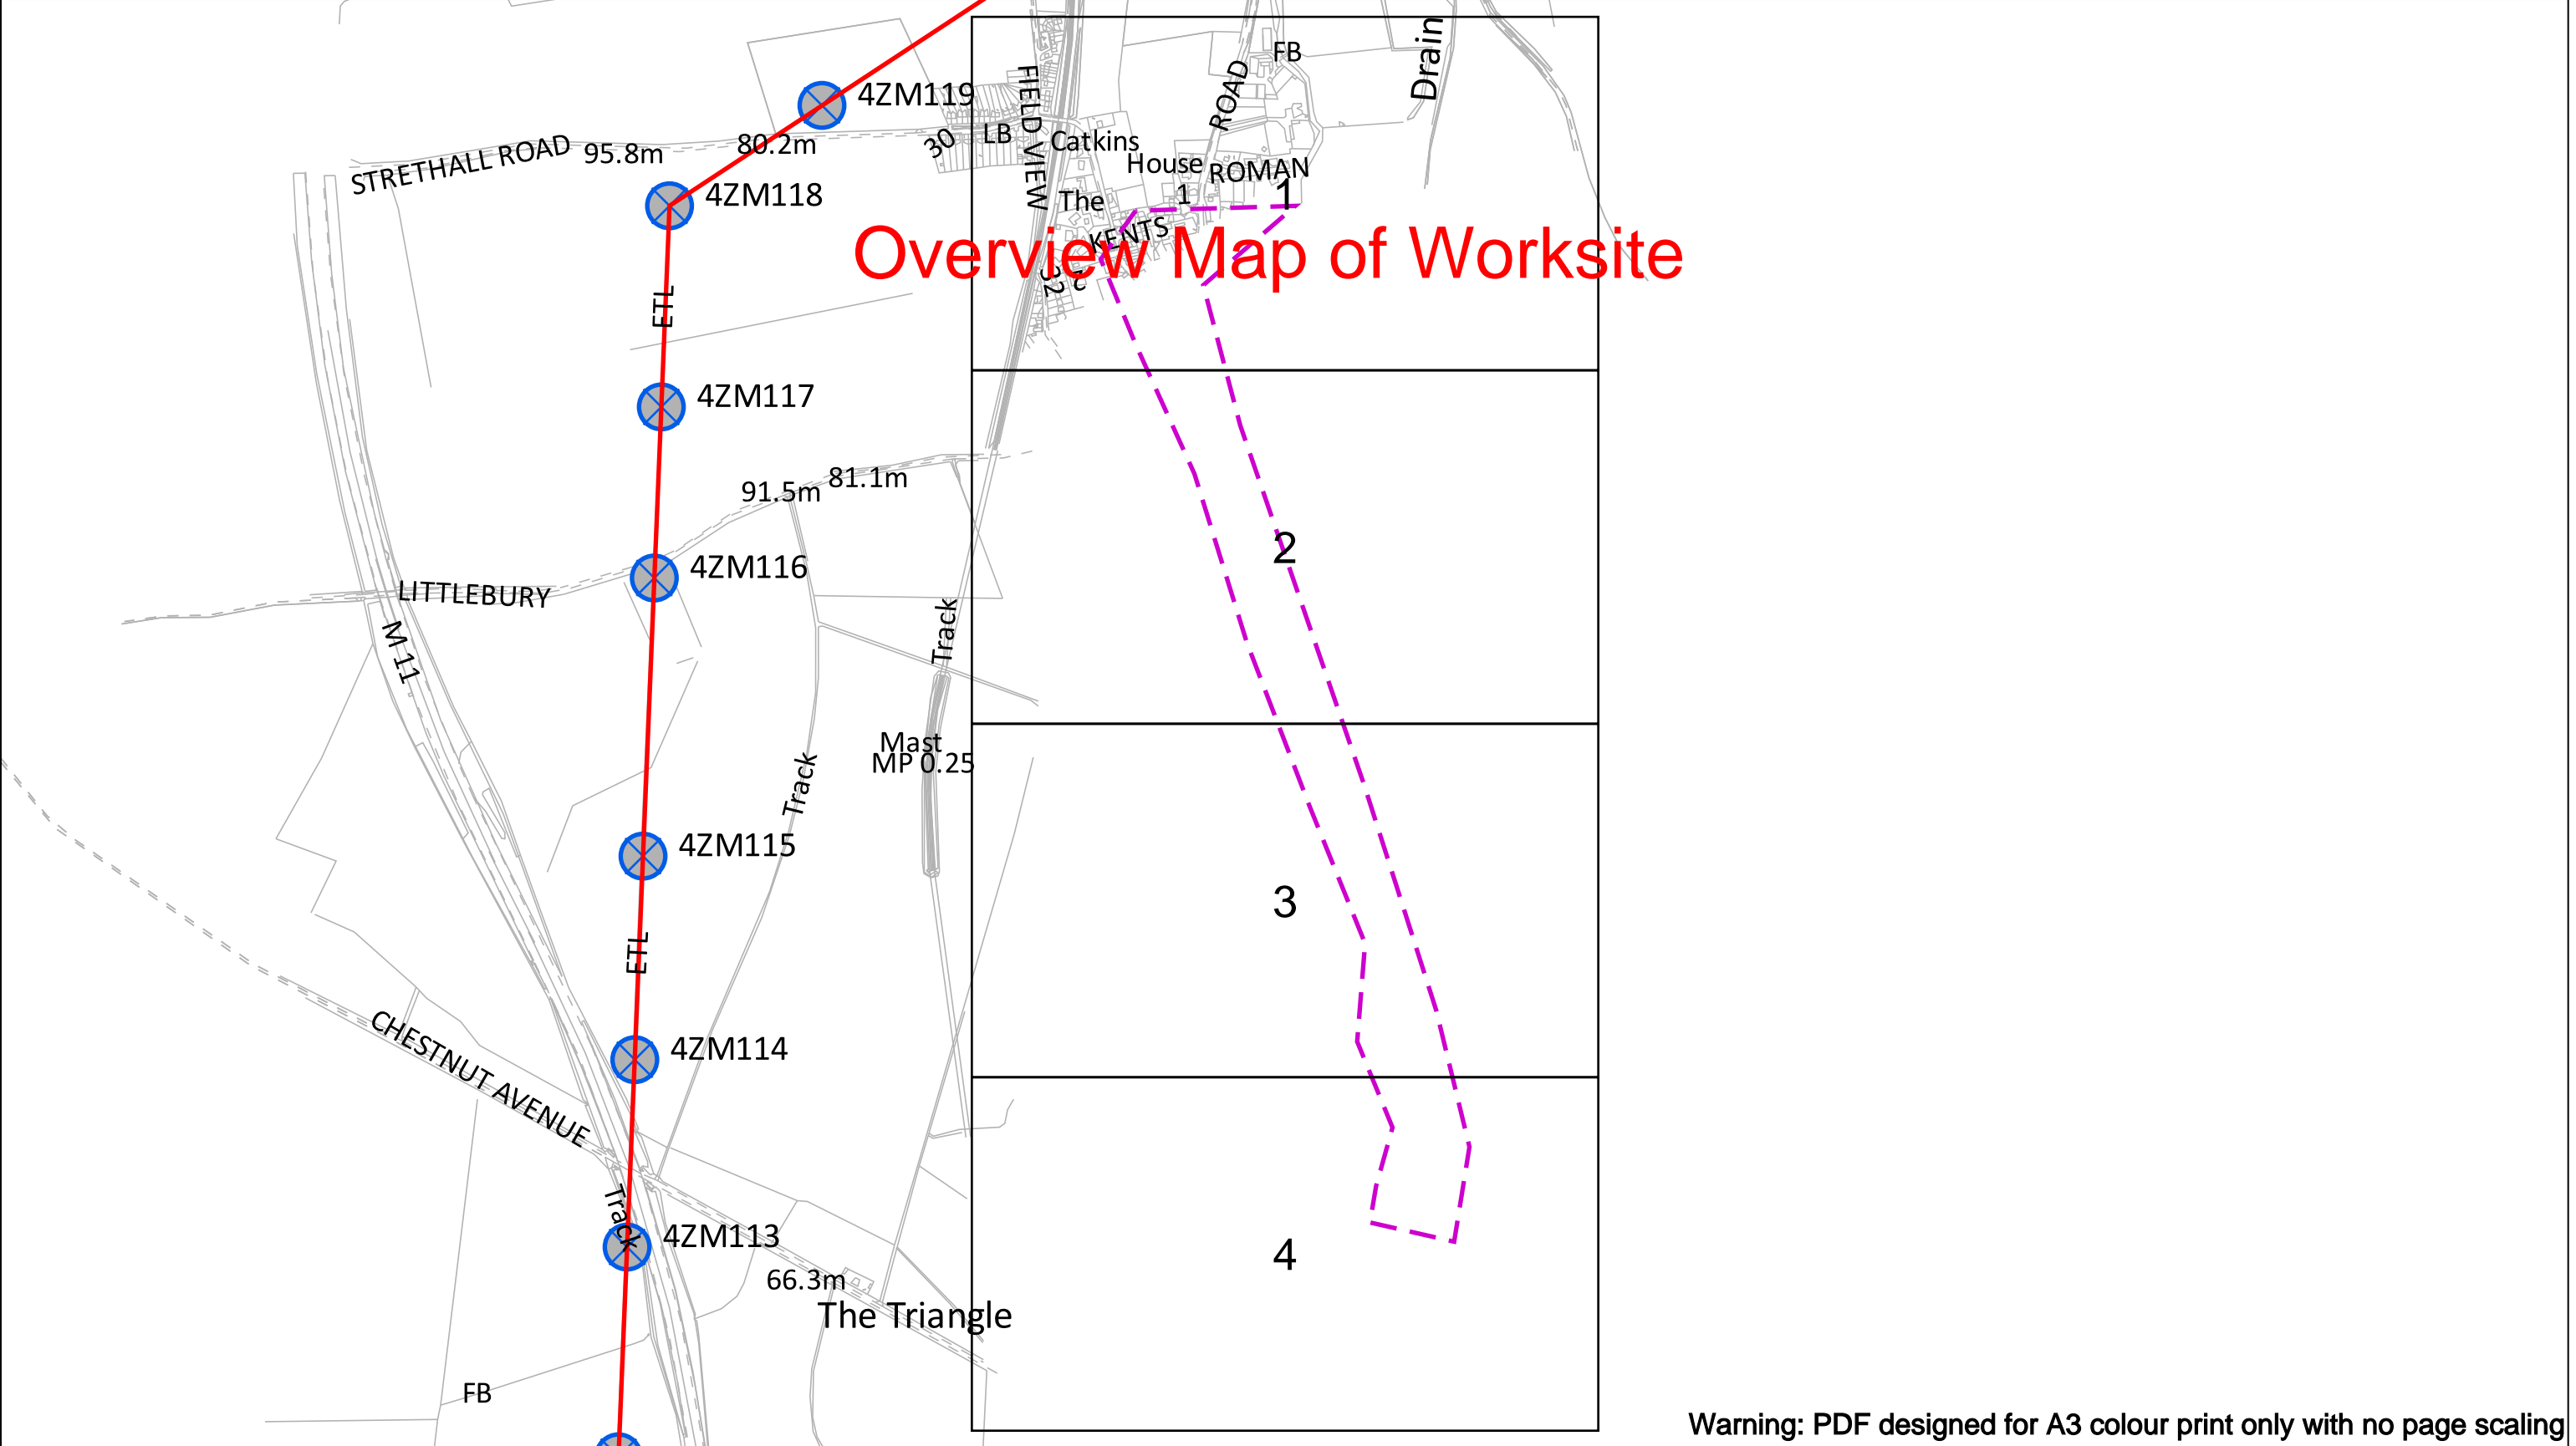


Overview Map of Worksite

Warning: PDF designed for A3 colour print only with no page scaling

<p>Date Requested: 30/01/2023 Job Reference: 28349752 Site Location: 551875 238909 Requested by: Miss Margarita Ivanova Your Scheme/Reference: 14481 Great Chesterford</p> <p>Scale: 1:10250 (When plotted at A3)</p>	<div><div>EXTREME CAUTION - HIGH VOLTAGE **RISK OF DEATH OR SERIOUS INJURY**</div><div>IMPORTANT NOTICES This plan shows those pipes owned by National Grid Electricity Transmission plc in its role as a Licensed Electricity Transporter (ET). Electricity cables owned by other ETs, or otherwise privately owned, may be present in this area. Information with regards to such cables should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Ancillary equipment such as cooling systems and communication cables are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Grid Electricity Transmission plc or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of cables and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near electricity apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</div></div>	<div><div>National Grid Electricity Emergency Number: 0800 40 40 90 Available 24 hours, 7 days/week. Calls may be recorded and monitored</div><div><div>Dig Sites</div><div>Area: </div><div>Line: </div></div><div><div></div>Underground Cables</div><div><div></div>Overhead Lines</div><div><div></div>Fibre Cables</div></div>	<div><div>Warning: PDF designed for colour print only with no page scaling</div><div></div><div>NationalGrid House Warwick Technology Park Gallows Hill Warwick CV34 6DA</div><div>AssetProtection@NationalGrid.com</div></div>
<p>Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100059731</p>			

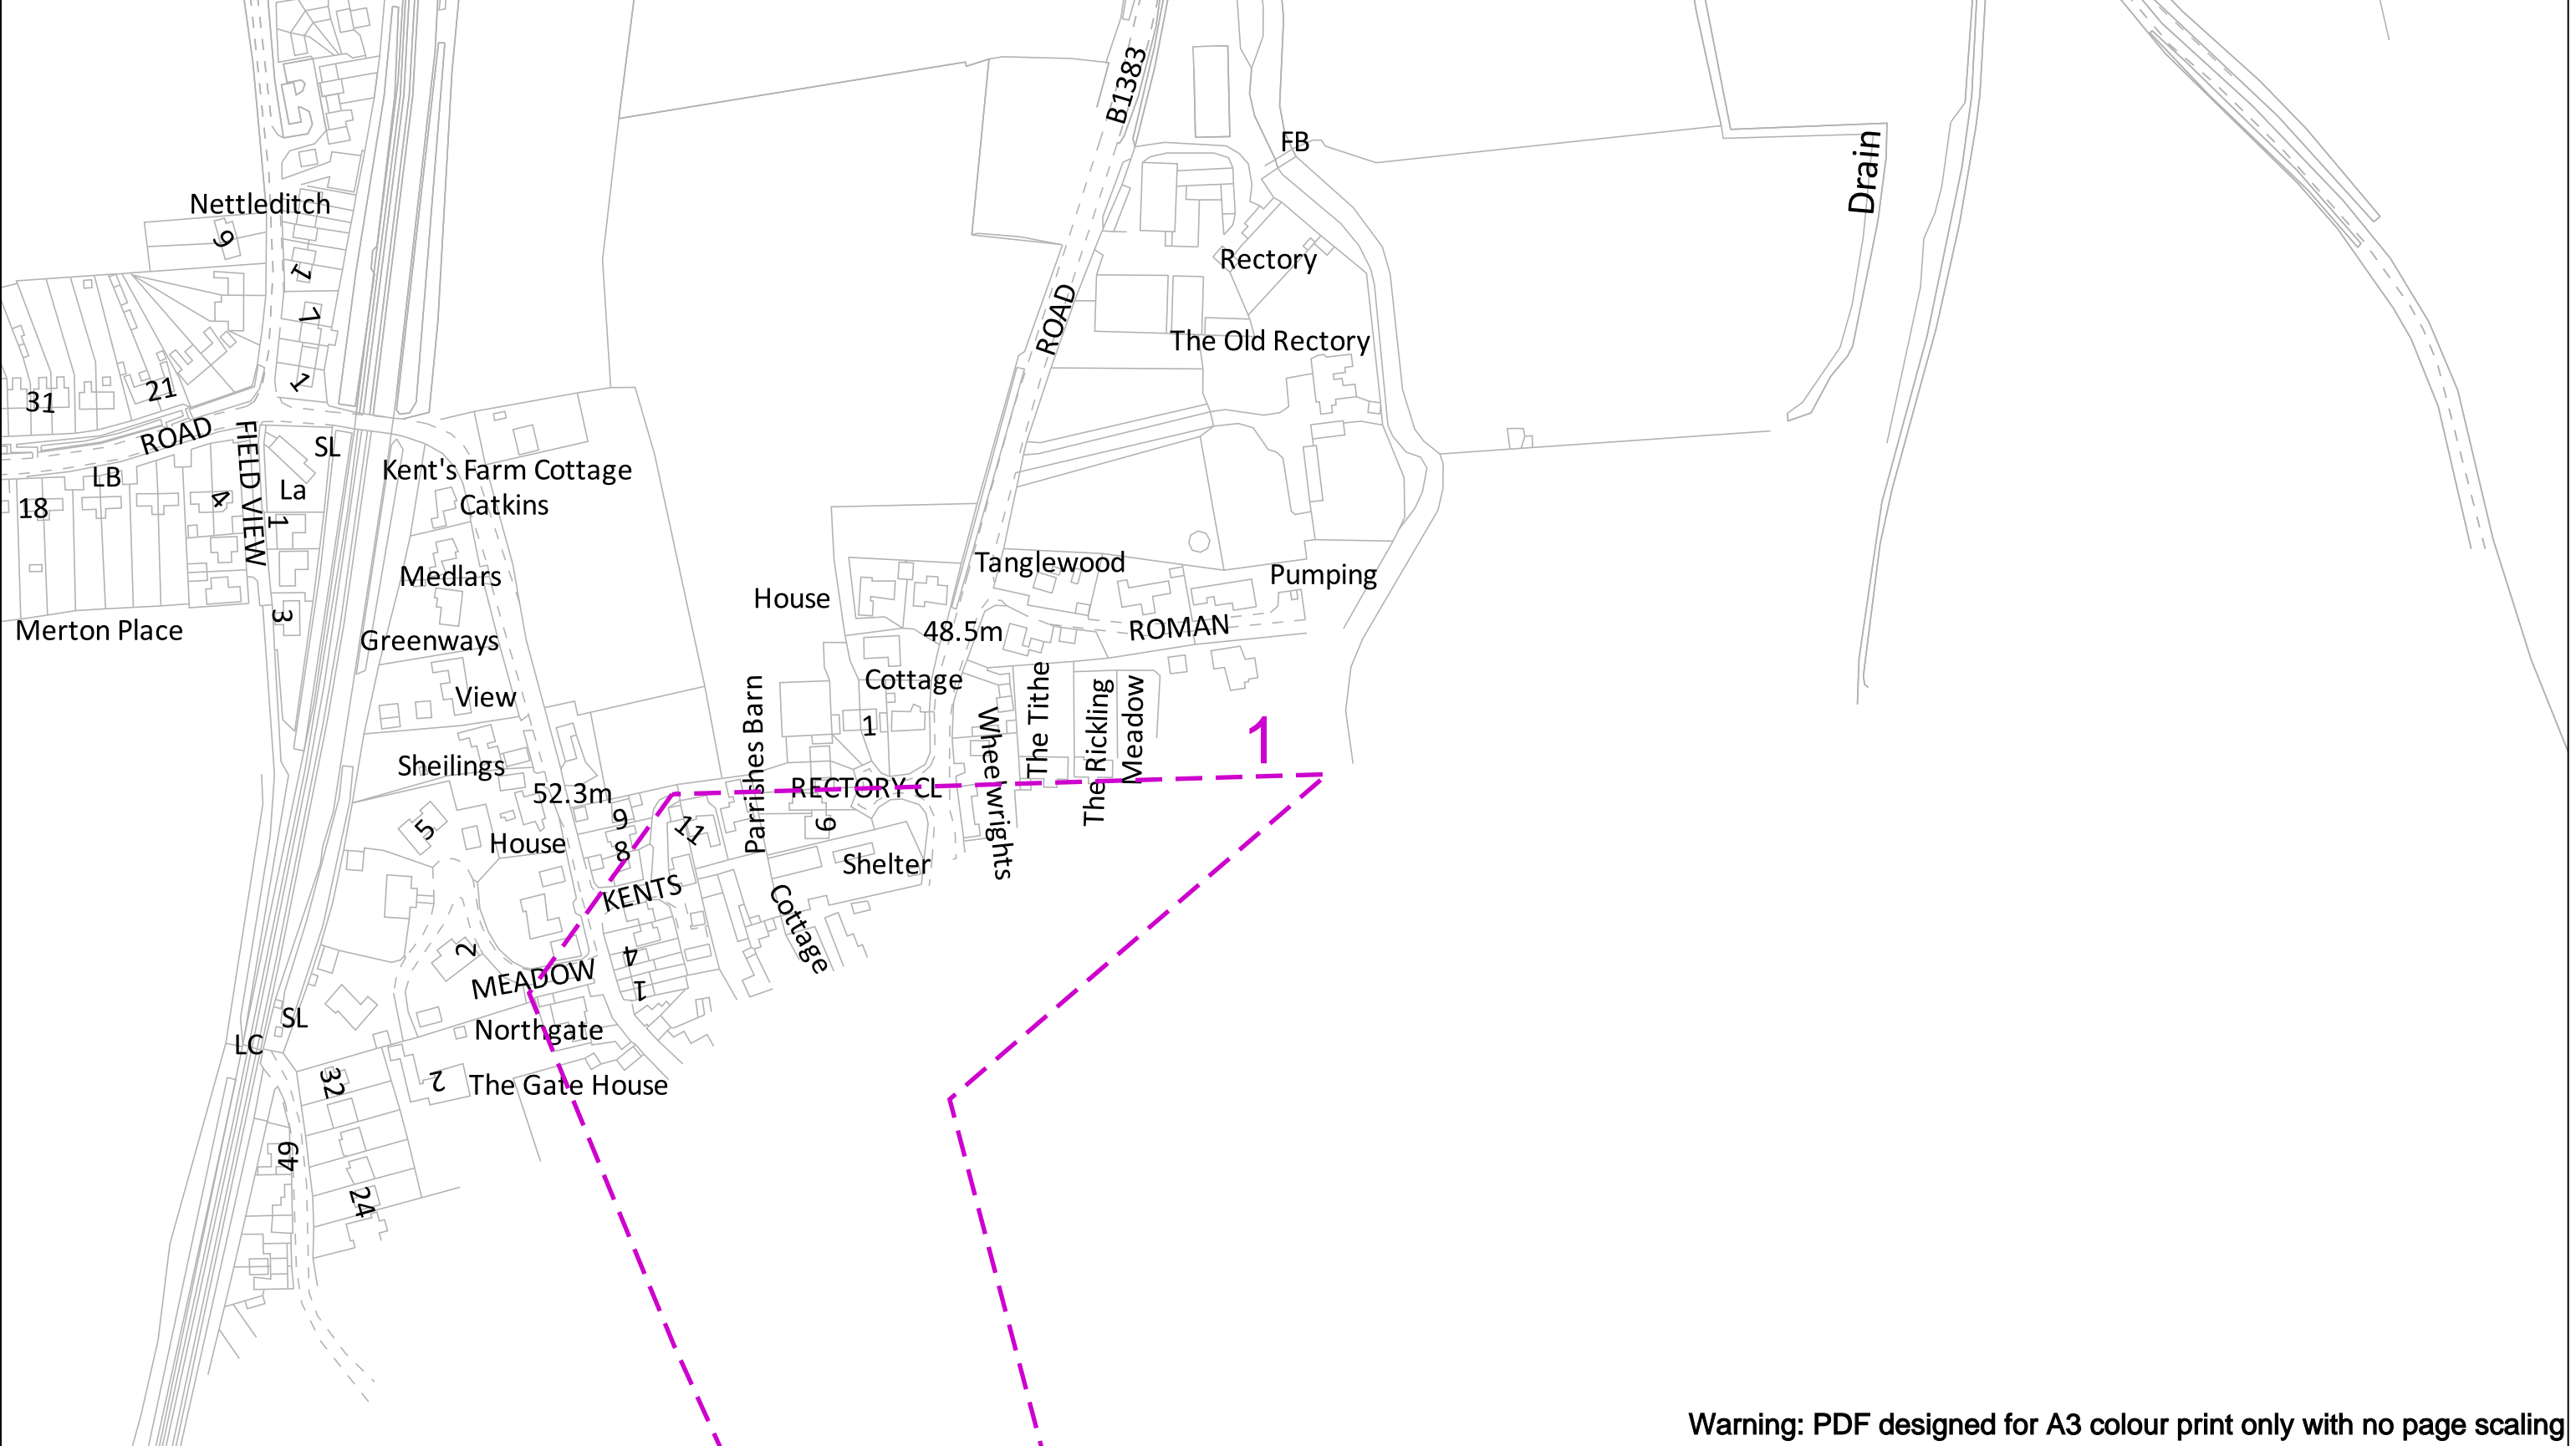


<p>EXTREME CAUTION - HIGH VOLTAGE **RISK OF DEATH OR SERIOUS INJURY**</p>		<p>National Grid Electricity Emergency Number: 0800 40 40 90 Available 24 hours, 7 days/week. Calls may be recorded and monitored</p>		<p>Warning: PDF designed for colour print only with no page scaling</p>			
<p>Date Requested: 30/01/2023 Job Reference: 28349752 Site Location: 551875 238909 Requested by: Miss Margarita Ivanova Your Scheme/Reference: 14481 Great Chesterford</p>		<p>IMPORTANT NOTICES This plan shows those pipes owned by National Grid Electricity Transmission plc in its role as a Licensed Electricity Transporter (ET). Electricity cables owned by other ETs, or otherwise privately owned, may be present in this area. Information with regards to such cables should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Ancillary equipment such as cooling systems and communication cables are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Grid Electricity Transmission plc or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of cables and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near electricity apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</p>		<p>0 200 m</p> <p>Dig Sites Area: Line: </p> <p> Underground Cables Overhead Lines Fibre Cables</p>		<p>nationalgrid</p> <p>NationalGrid House Warwick Technology Park Gallows Hill Warwick CV34 6DA</p> <p>AssetProtection@NationalGrid.com</p>	
<p>Scale: 1:2500 (When plotted at A3)</p>							
<p>Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100059731</p>							

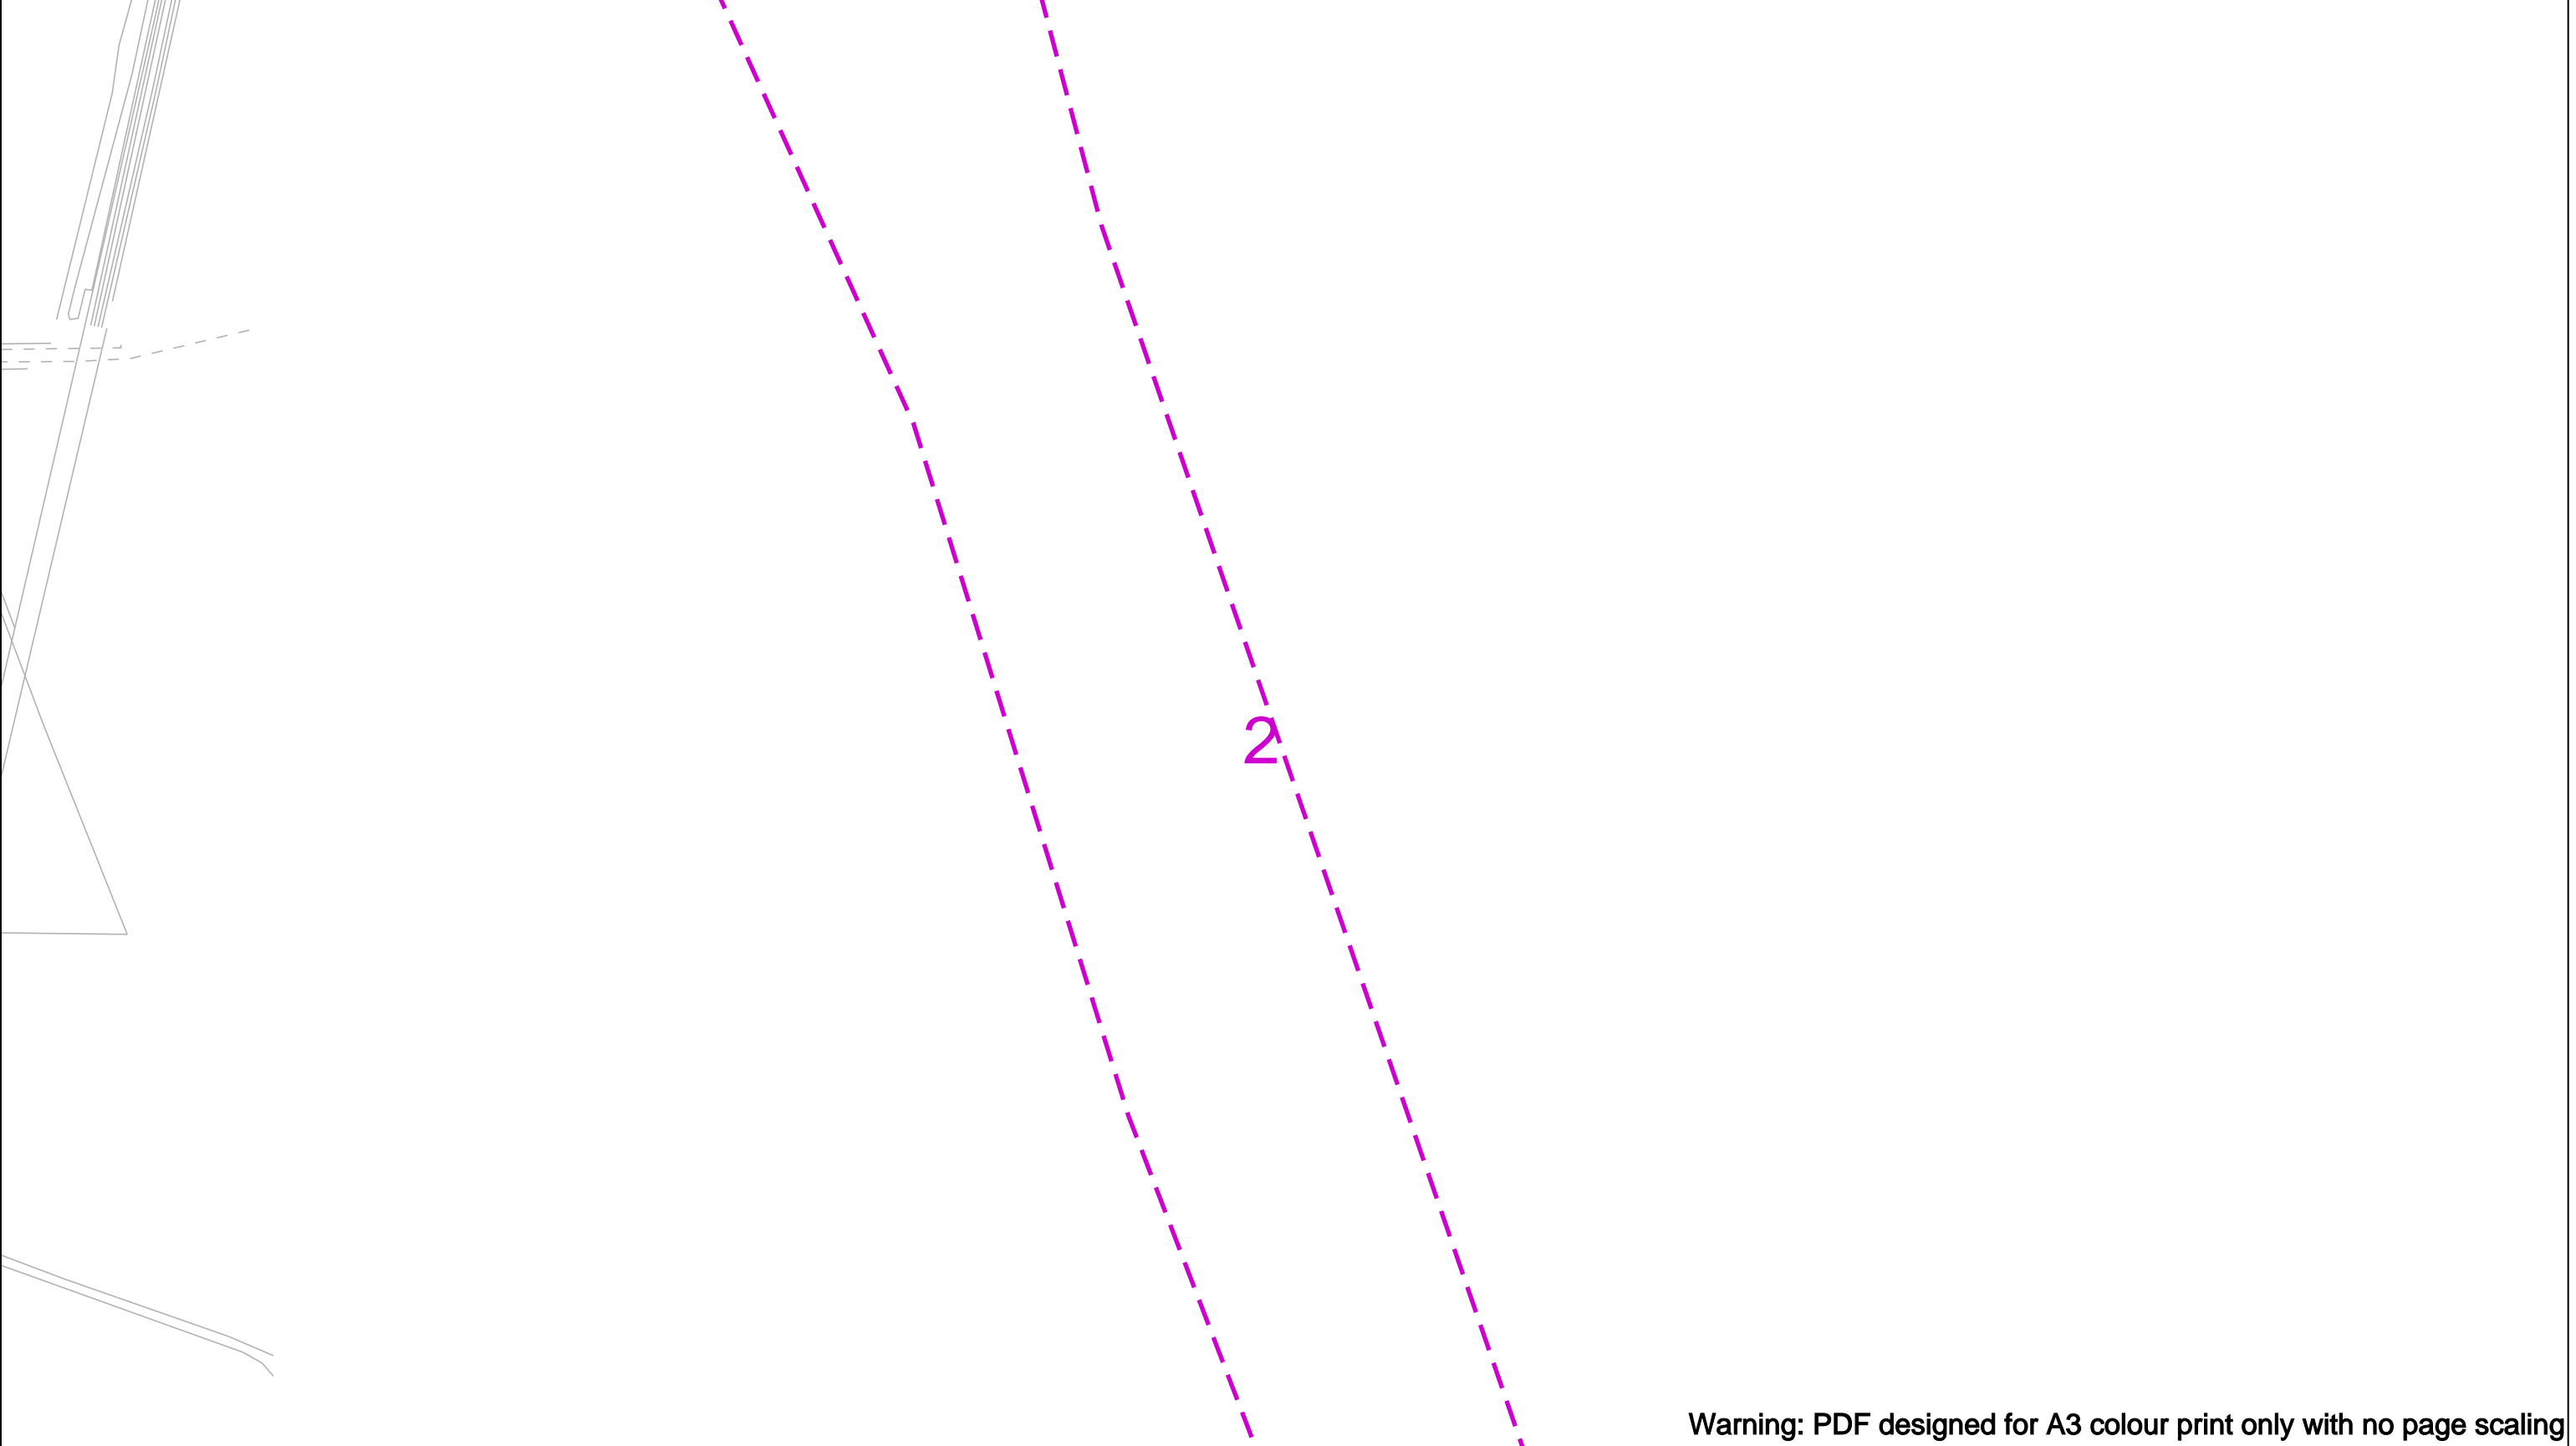


Warning: PDF designed for A3 colour print only with no page scaling

<div>EXTREME CAUTION - HIGH VOLTAGE **RISK OF DEATH OR SERIOUS INJURY**</div>		<div>National Grid Electricity Emergency Number: 0800 40 40 90 Available 24 hours, 7 days/week. Calls may be recorded and monitored</div>		<div>Warning: PDF designed for colour print only with no page scaling</div>	
<div>Date Requested: 30/01/2023 Job Reference: 28349752 Site Location: 551875 238909 Requested by: Miss Margarita Ivanova Your Scheme/Reference: 14481 Great Chesterford</div>		<div><div>IMPORTANT NOTICES</div><div>This plan shows those pipes owned by National Grid Electricity Transmission plc in its role as a Licensed Electricity Transporter (ET). Electricity cables owned by other ETs, or otherwise privately owned, may be present in this area. Information with regards to such cables should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Ancillary equipment such as cooling systems and communication cables are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Grid Electricity Transmission plc or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of cables and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near electricity apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</div></div>			
<div>Scale: 1:2500 (When plotted at A3)</div>		<div><div>0200 m</div><div><div>Dig Sites</div><div>Area: <div></div></div><div>Line: <div></div></div></div><div><div><div></div></div><div><div></div></div><div><div></div></div></div><div><div>Underground Cables</div><div>Overhead Lines</div><div>Fibre Cables</div></div></div>			
<div><div>nationalgrid</div><div><div>NationalGrid House</div><div>Warwick Technology Park</div><div>Gallows Hill</div><div>Warwick</div><div>CV34 6DA</div></div><div>AssetProtection@NationalGrid.com</div></div>					
<div>Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100059731</div>					

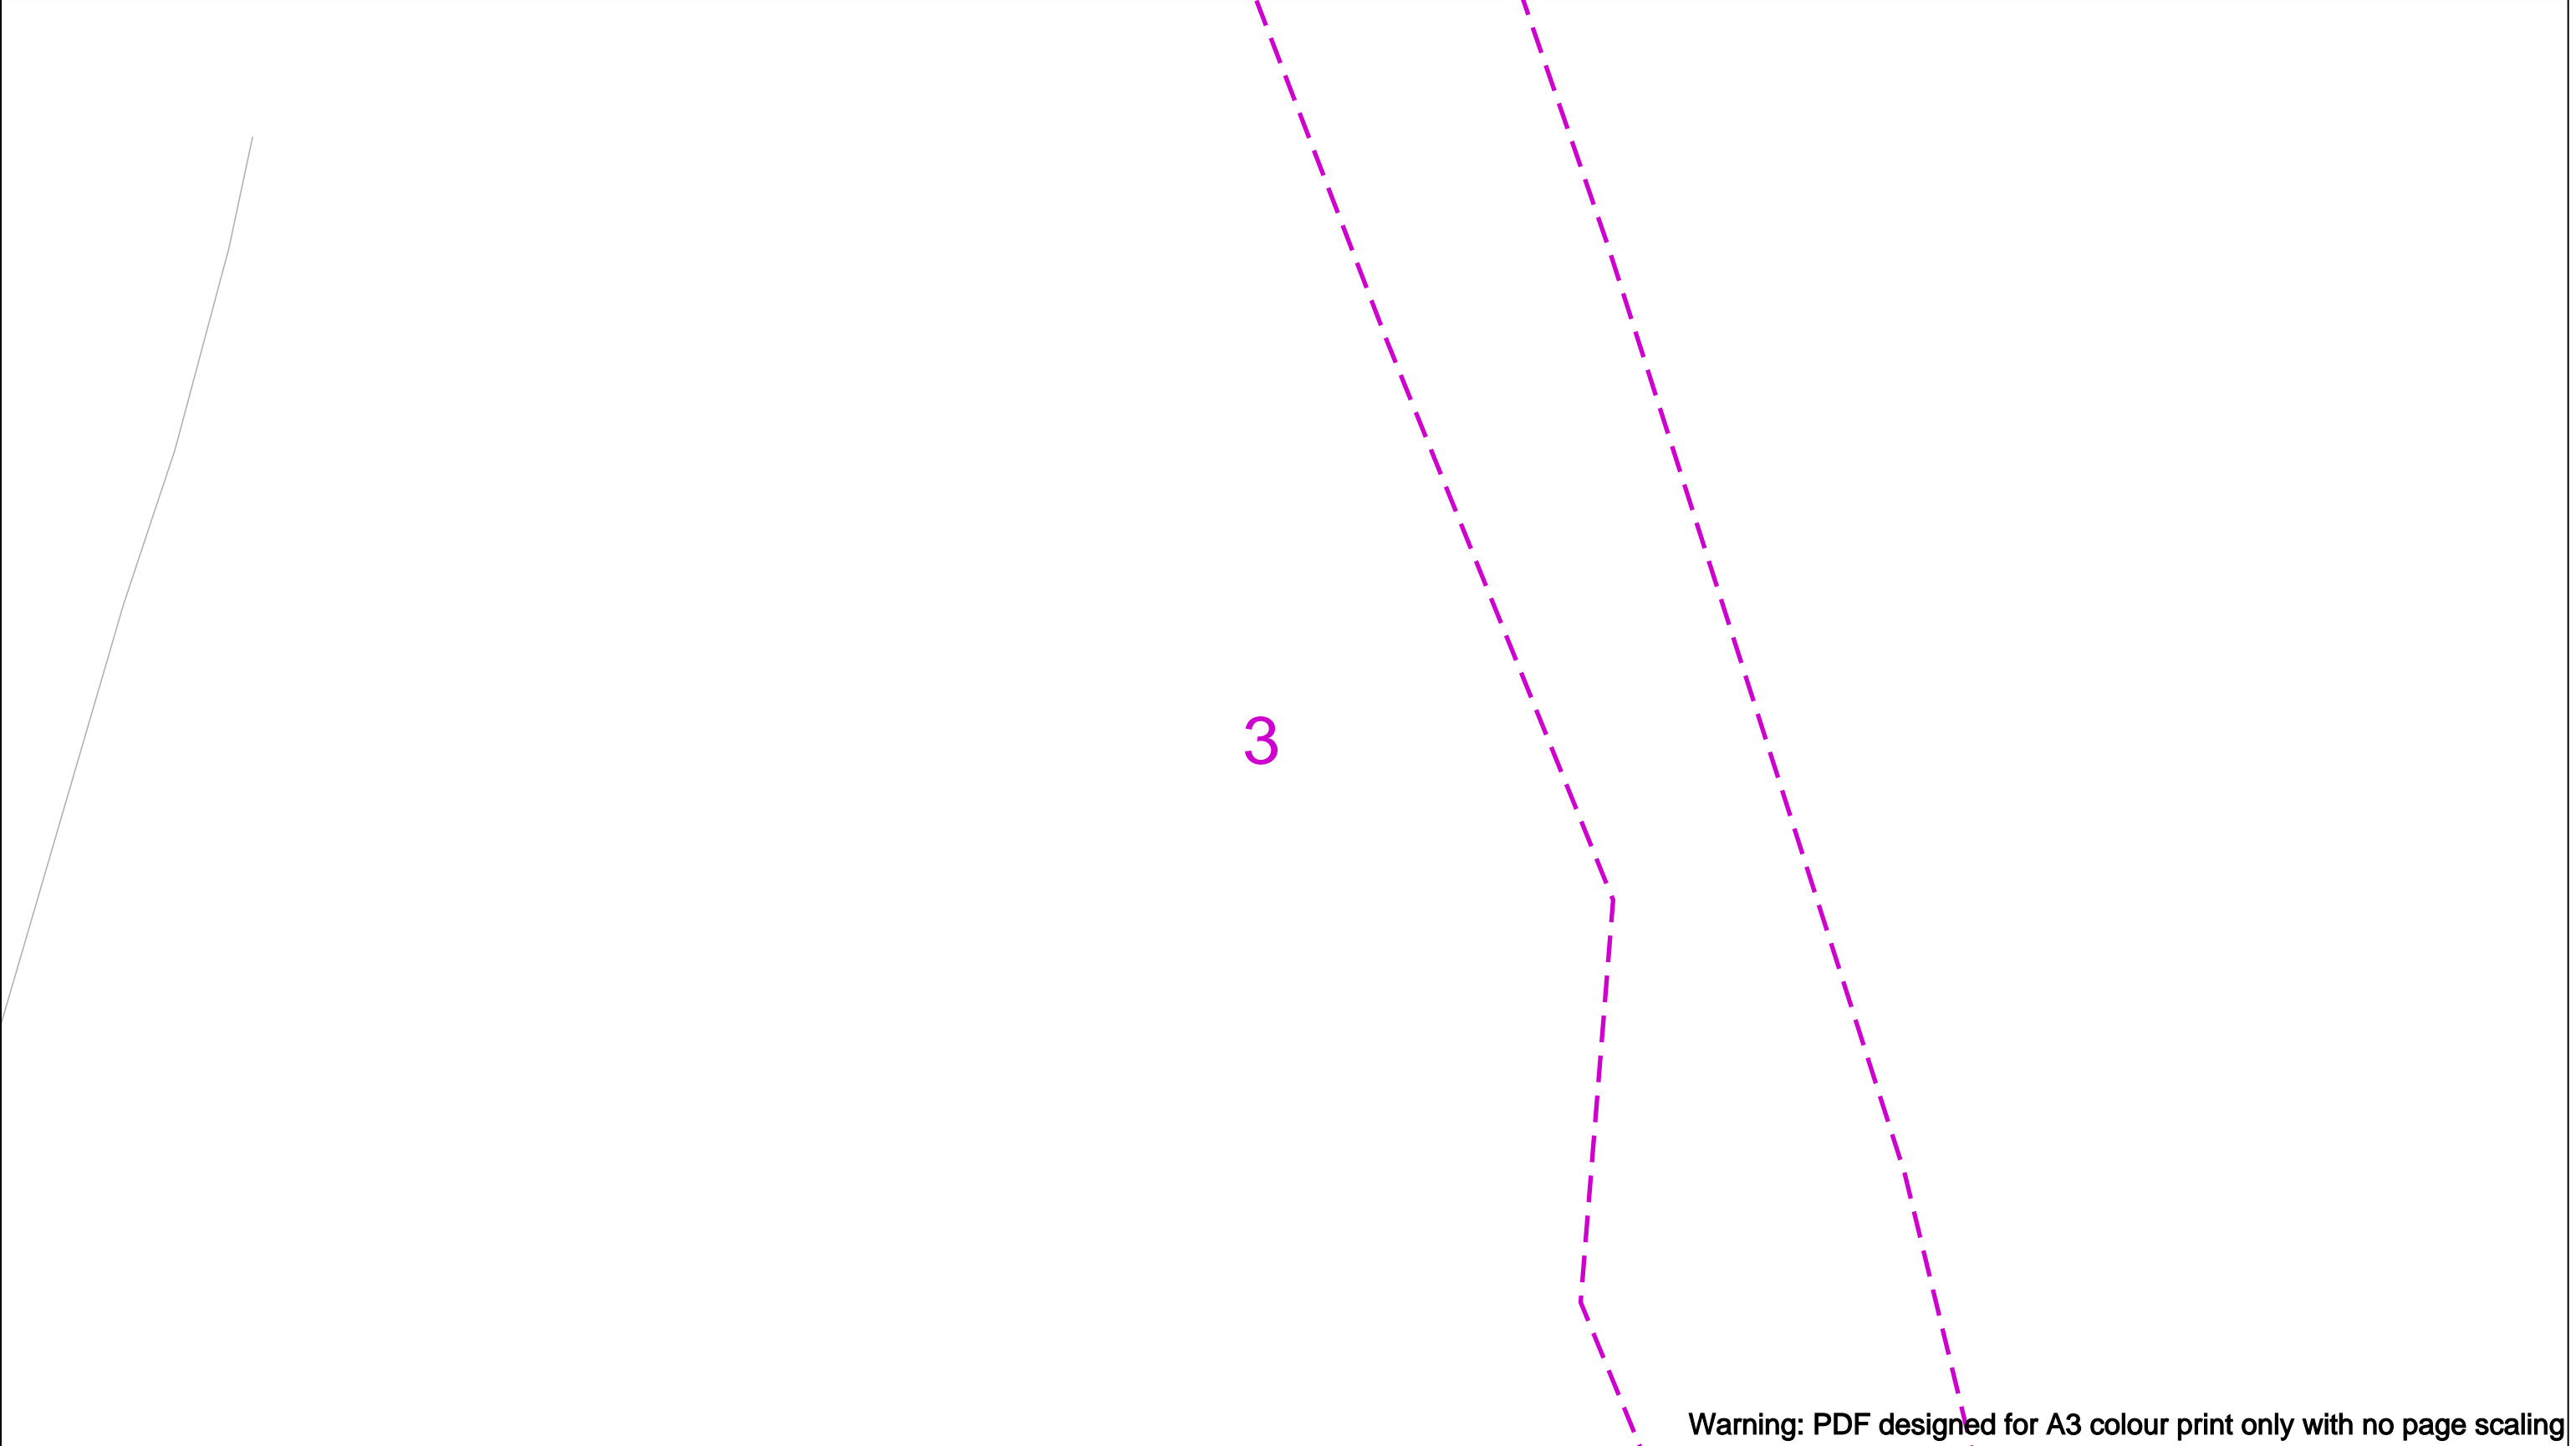





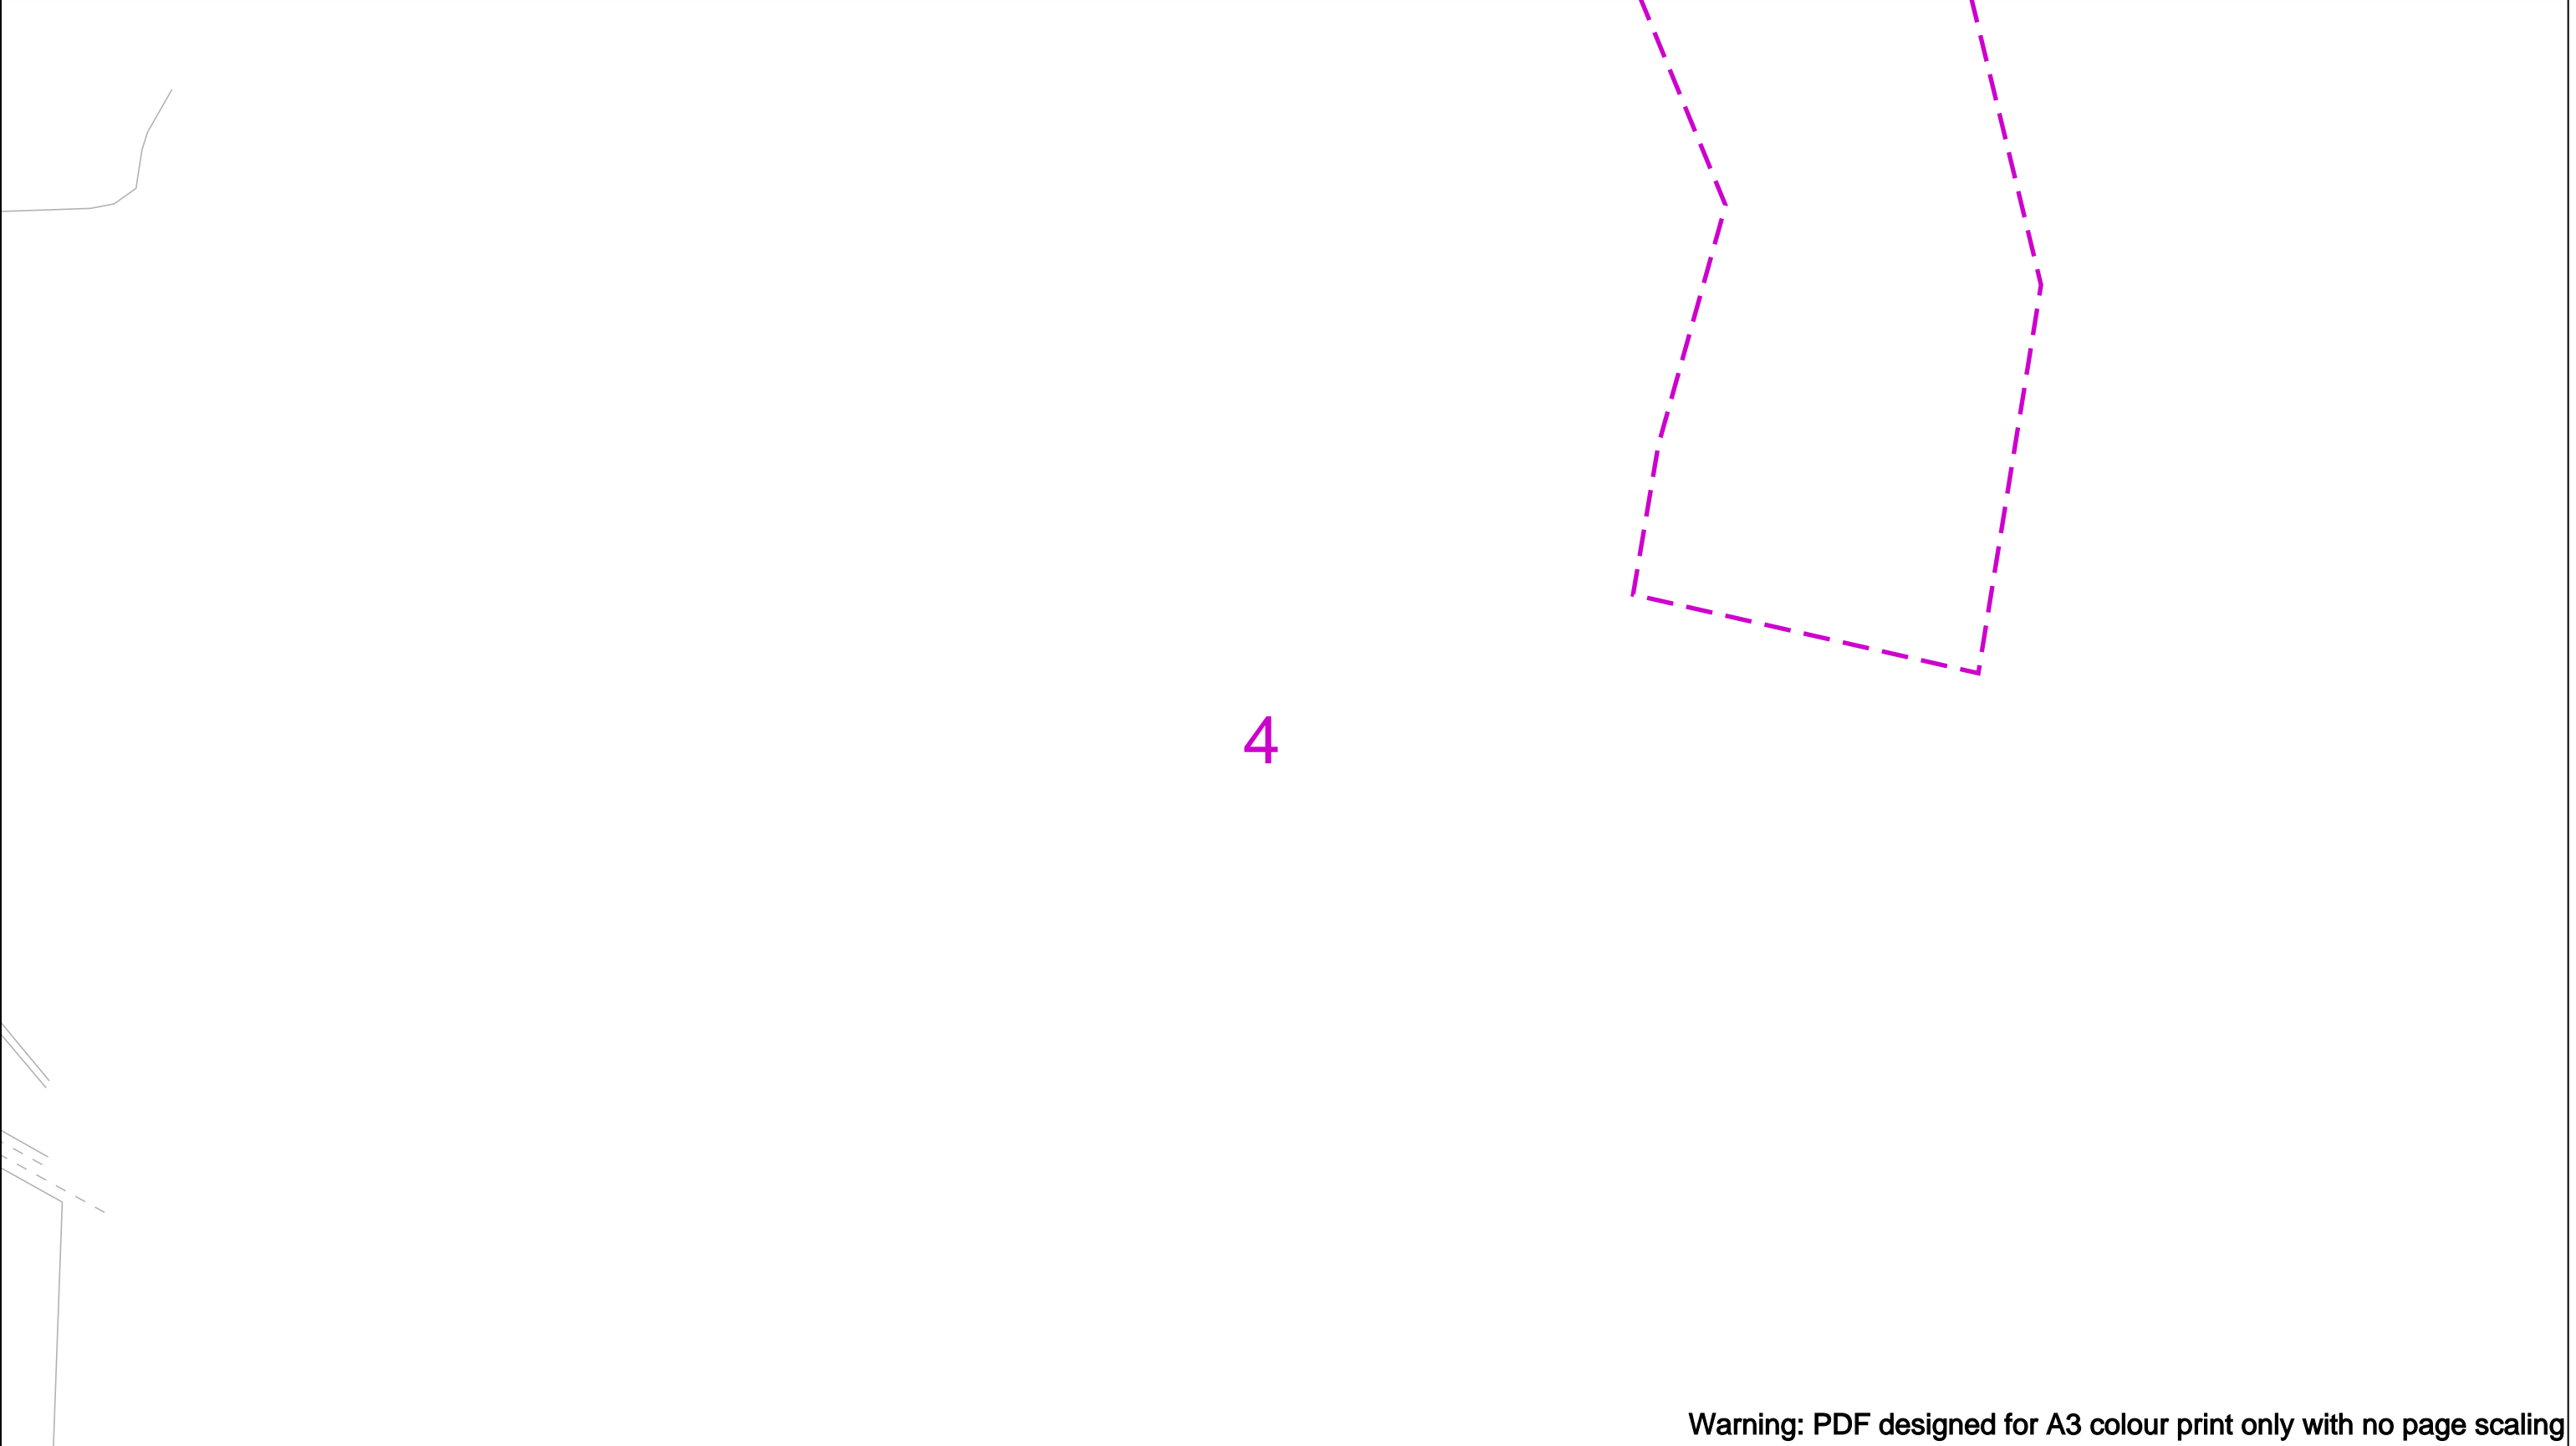

Warning: PDF designed for A3 colour print only with no page scaling

<div>EXTREME CAUTION - HIGH VOLTAGE **RISK OF DEATH OR SERIOUS INJURY**</div>		<div>National Grid Electricity Emergency Number: 0800 40 40 90 Available 24 hours, 7 days/week. Calls may be recorded and monitored</div>		<div>Warning: PDF designed for colour print only with no page scaling</div>	
<div>Date Requested: 30/01/2023 Job Reference: 28349752 Site Location: 551875 238909 Requested by: Miss Margarita Ivanova Your Scheme/Reference: 14481 Great Chesterford</div>		<div><div>IMPORTANT NOTICES</div><div>This plan shows those pipes owned by National Grid Electricity Transmission plc in its role as a Licensed Electricity Transporter (ET). Electricity cables owned by other ETs, or otherwise privately owned, may be present in this area. Information with regards to such cables should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Ancillary equipment such as cooling systems and communication cables are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Grid Electricity Transmission plc or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of cables and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near electricity apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</div></div>			
<div>Scale: 1:2500 (When plotted at A3)</div>		<div><div>0200 m</div><div><div>Dig Sites</div><div>Area: <div></div></div><div>Line: <div></div></div><div><div><div></div></div>Underground Cables</div><div><div></div></div>Overhead Lines</div><div><div></div></div>Fibre Cables</div>			



Warning: PDF designed for A3 colour print only with no page scaling

<div><div>EXTREME CAUTION - HIGH VOLTAGE **RISK OF DEATH OR SERIOUS INJURY**</div><div><p>IMPORTANT NOTICES</p><p>This plan shows those pipes owned by National Grid Electricity Transmission plc in its role as a Licensed Electricity Transporter (ET). Electricity cables owned by other ETs, or otherwise privately owned, may be present in this area. Information with regards to such cables should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Ancillary equipment such as cooling systems and communication cables are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Grid Electricity Transmission plc or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of cables and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near electricity apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</p></div></div>		<div><div><div><div>National Grid Electricity Emergency Number: 0800 40 40 90</div><div>Available 24 hours, 7 days/week. Calls may be recorded and monitored</div></div><div><div>Warning: PDF designed for colour print only with no page scaling</div></div></div><div><div>0200 m</div><div><div>Dig Sites</div><div>Area: </div><div>Line: </div></div><div><div></div><div>Underground Cables</div></div><div><div></div><div>Overhead Lines</div></div><div><div></div><div>Fibre Cables</div></div></div></div>	<div><div></div><div><div>NationalGrid House</div><div>Warwick Technology Park</div><div>Gallows Hill</div><div>Warwick</div><div>CV34 6DA</div></div><div>AssetProtection@NationalGrid.com</div></div>
<div>Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100059731</div>			

Date Requested: 30/01/2023
Job Reference: 28349752
Site Location: 551875 238909
Requested by:
Miss Margarita Ivanova
Your Scheme/Reference: 14481 Great Chesterford

Scale: 1:2500 (When plotted at A3)

ENQUIRY SUMMARY

Received Date

30/01/2023 20:51

Work Start Date

31/01/2023

Your Reference

14481 Great Chesterford

Location

Centre Point: 551875 238909

X Extent:

Y Extent:

Postcode: CB114JG

Map Options

Paper Size: A3

Orientation: LANDSCAPE

Scale: 1:2500

Real World Extents: 598m x 1680m

Enquirer Details

Organisation Name: Sustrans

Contact Name: Margarita Ivanova

Email Address: margo.m.ivanova@gmail.com

Telephone: 447706502031

Address: Lancaster Gate Lancaster Gate, , London, w2 3lp

Enquiry Type

Planned Works

Activity Type

Highways

Work Types

C2 Enquiry (Stat Undertakers only)

Notes/Works Description (if supplied)

- CONTINUED FROM JOB: 28349750 -

Site Contact Name (if supplied)

Margarita Ivanova

Site Contact Number (if supplied)

+447706502031